



REVISIONS			
ZONE	REV	DESCRIPTION	DATE

ITEM NO. -- 

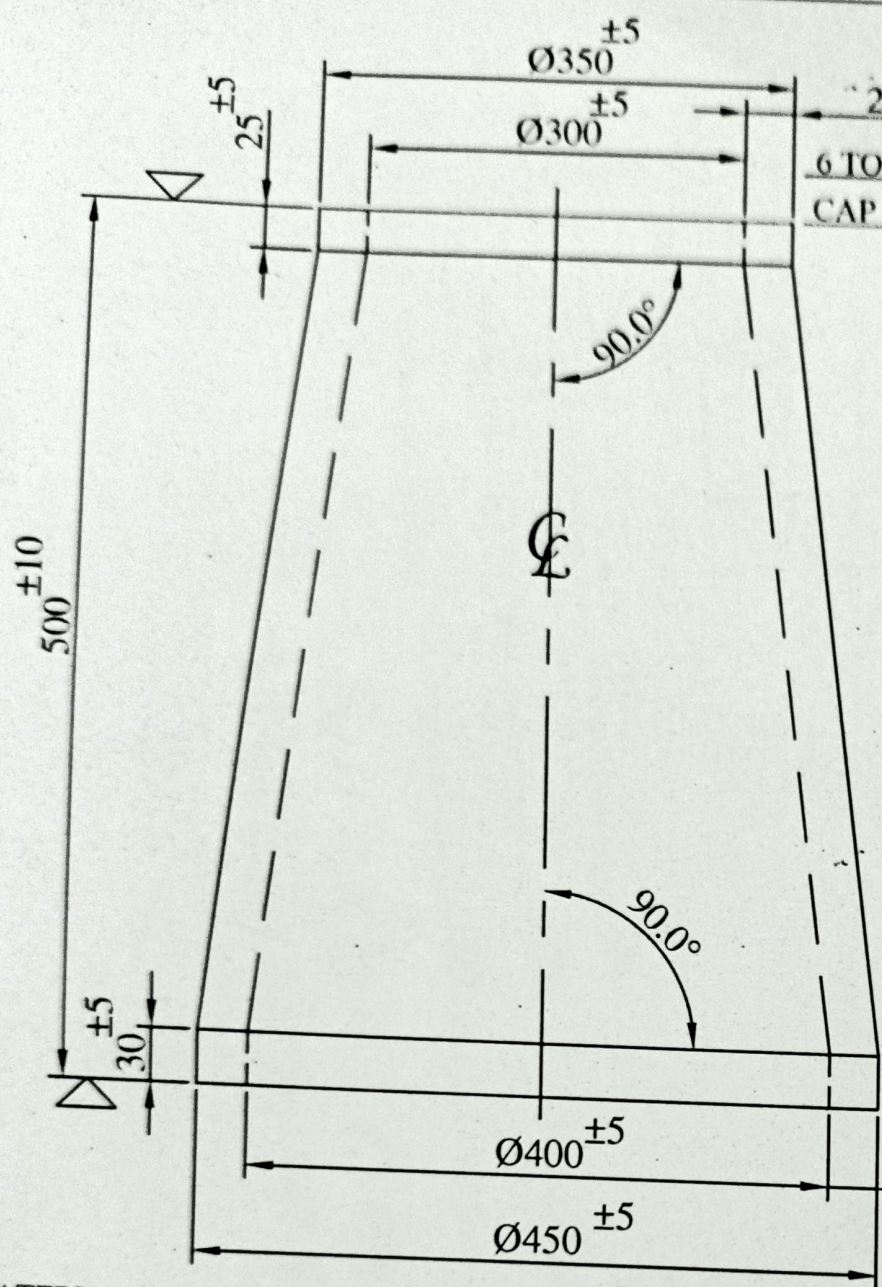

6 TONS DISTRIBUTED ON STEEL CAP WITH ASBESTOS GASKET

QTY.- 13 NOS

INSULATOR WILL BE MOUNTED ON A STEEL BASE PLATE WITH ASBESTOS GASKET 6 THK

MATERIAL : ALUMINA BASED PORCELAIN (Al_2O_3 , 50 to 60%)
 FINISH : GRIND ENDS PARALLEL & SQUARE TO AXIS

- WORKING VOLTAGE - 95 KV DC
- WET FLASH- OVER VOLTAGE - 125 KV
- DRY FLASH- OVER VOLTAGE - 145 KV
- IMPULSE FLASH - OVER VOLTAGE - 250 KV

BOTH FACE OF INSULATOR MUST BE PARALLEL TO EACH OTHER .